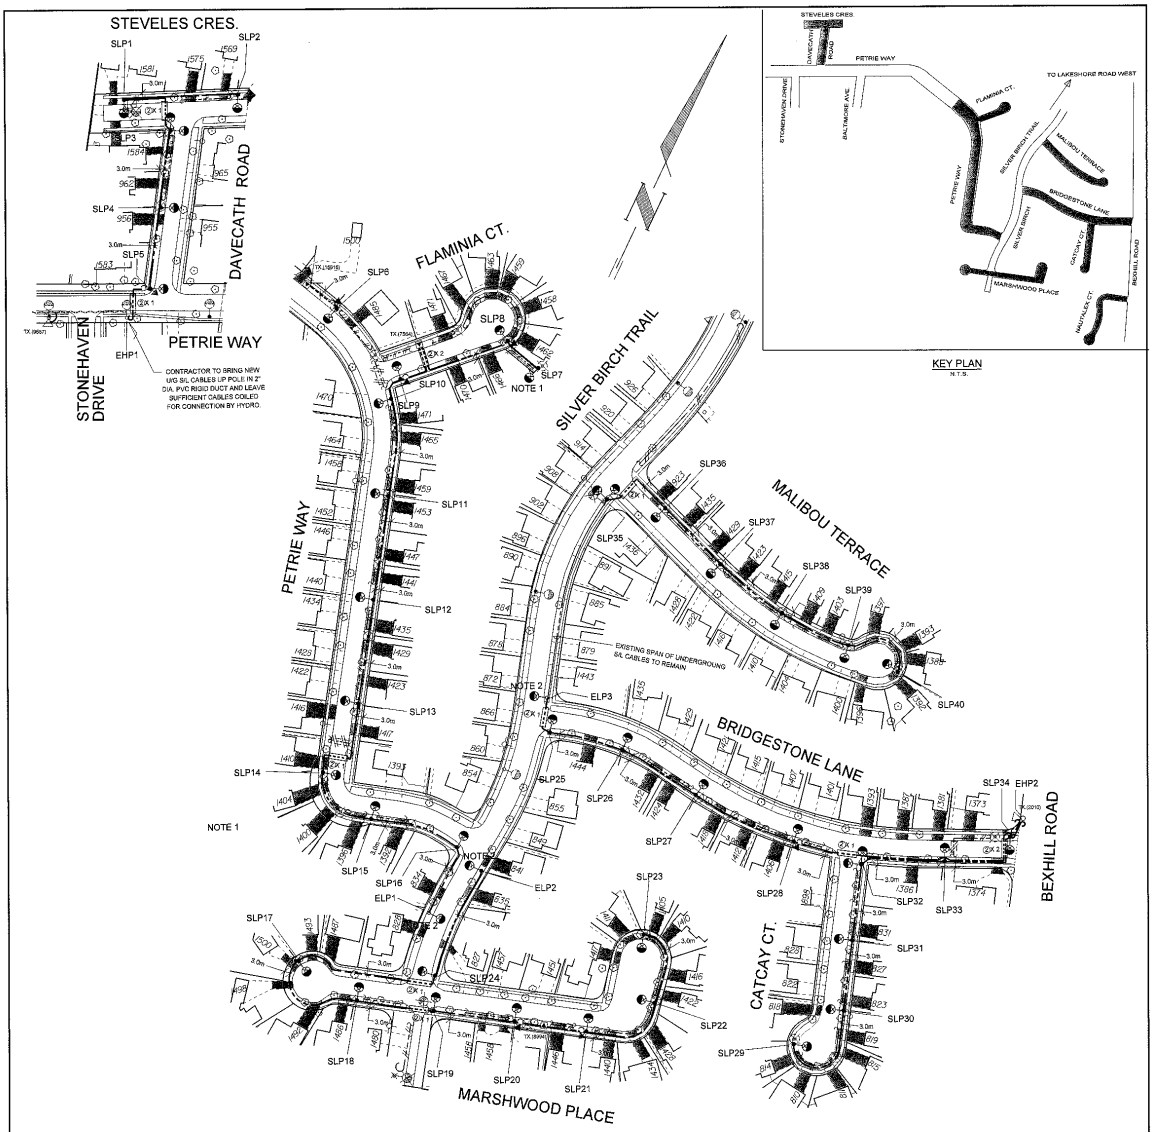



LEGEND

- INSTALL NEW 'COBRA HEAD' 100W HPS LUMINAIRE C/W PHOTOCELL AND 8' AL. BRACKET ON 32.0' CONCRETE POLE BY CONTRACTOR
- EXISTING HPS 'COBRA HEAD' LUMINAIRE C/W 8' BRACKET TO REMAIN.
- REMOVE EXISTING 'COBRA HEAD' LUMINAIRE C/W 32.0' CONCRETE POLE.(BY CONTRACTOR)
- REMOVE EXISTING POST-TOP-CIRCULETTE LUMINAIRE C/W 19'-2" AL. POLE (BY CONTRACTOR)
- EXISTING S/L OR HYDRO POLE.
- EXISTING UNDERGROUND STREETLIGHTING CABLES TO REMAIN
- INSTALL 3C-#6AWG Cu. RWU90 U/G (BLACK, RED & GREEN) IN 2" DIA. POLYPRE DUCT. (BY CONTRACTOR)
- DISCONNECT AND ABANDON EXISTING U/G S/L CABLES.
- EXISTING OVERHEAD 120/240V SEC. BUS.
- EXISTING POLE MOUNT 120/240V SUPPLY TRANSFORMER.
- EXISTING MINI-PAD 120/240V SUPPLY TRANSFORMER
- NEW S/L ROAD CROSSING (SIZE AND QUANTITY AS SHOWN) BY CONTRACTOR
- EXISTING S/L ROAD CROSSING TO BE ABANDONED
- EXISTING CONTROL RELAY TO BE REMOVED BY HYDRO.
- 50A, 240V IN-POLE BREAKER (BY CONTRACTOR)
- GROUNDING BY CONTRACTOR

REV. NO.	REVISION	REV. BY	APPD.	DATE

enersource Hydro Mississauga

3240 Mavis Road
Mississauga, Ontario
L5C 1R1
Tel. (905) 270-4055
Fax (905) 896-5137
www.enersourcehydro.com

DEC.POST-TOP STREET LIGHT REPLACEMENT - PETRIE,CATCAY, BRIDGESTONE,MALIBOU,FLAMINIA,DAVECATH MARSHWOOD,NAUTALEX & STEEVLES

SCALE 1:1000 — 0 20 30 40 METRES

DES. TECH.	DRAWN	SERVICE ORDER	DATE
RAJ	RAJ	07-201216	JUNE-2007

REVISED BY	AREA	SHEET	
	3	1of2	DSL-07-201216-001